


NOTES:

1. REFERENCE ANSI/TIA/EIA 568B, COMMERCIAL BUILDING TELECOMMUNICATIONS CABLING STANDARD
2. WA (WORK AREA) CAN BE ANY NETWORK DEVICE SUCH AS: VMS, TVM, CCTV, CID OR DATA OUTLET
3. EACH UTP CABLE SHALL BE PROTECTED AT THE ENTRANCE OF THE DC OR CER BY USE OF APPROPRIATE SURGE / LIGHTING PROTECTOR

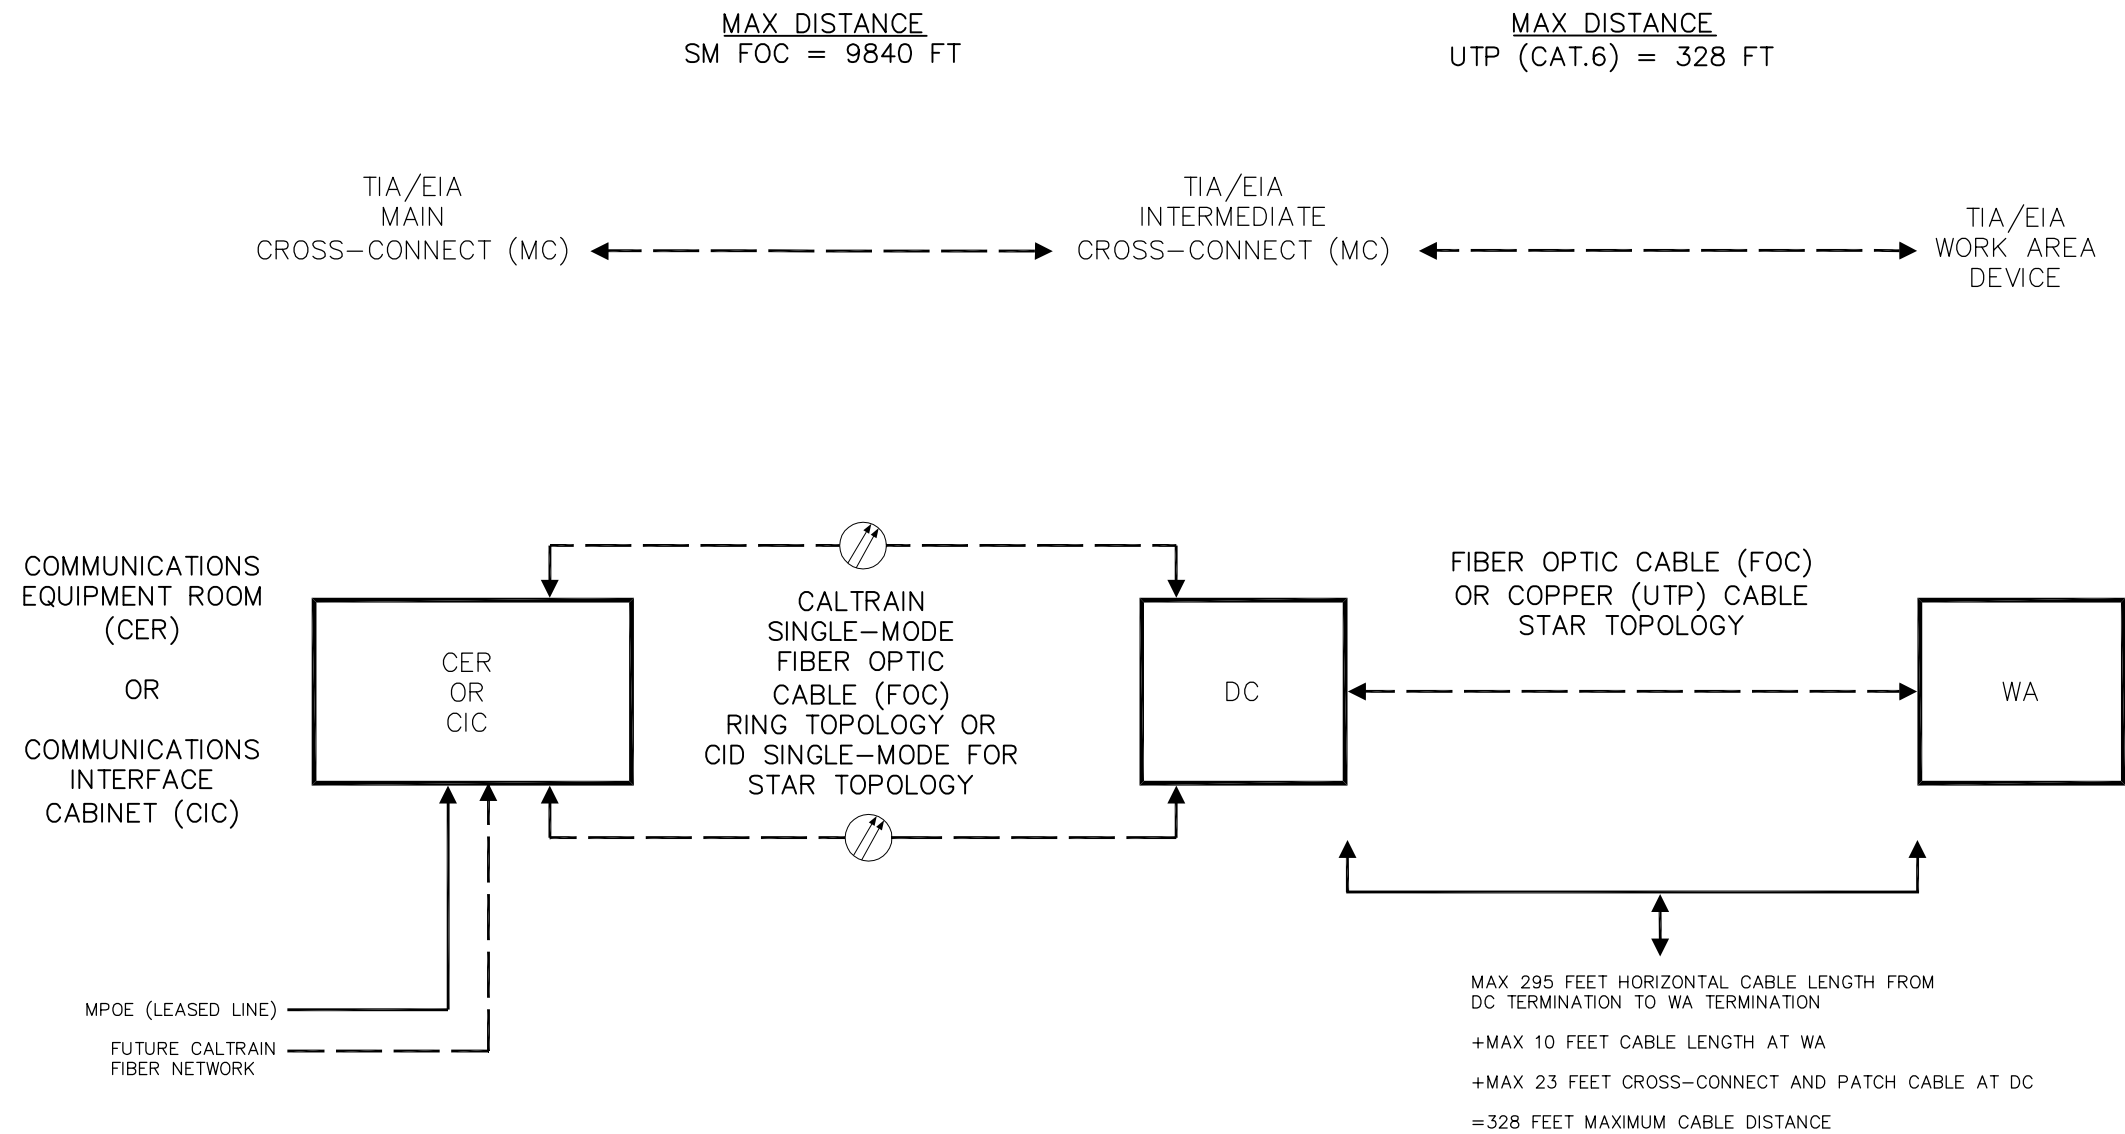

REV	DATE	BY	CHK	APP	DESCRIPTION

PENINSULA CORRIDOR JOINT POWERS BOARD

APPROVED BY:

ENGINEERING MANAGER

DEPUTY DIRECTOR OF ENGINEERING

1250 San Carlos Avenue
San Carlos, CA 94070

STANDARD DRAWINGS

STATION COMMUNICATIONS
OVERALL SYSTEM DESCRIPTIONS
NETWORK CABLE DISTRIBUTION
TIA / EIA STANDARDS

CADD FILE NO.: SD-4113	
REV	DATE
0	093011
STATION COMMS	
STANDARD NO.: SD-4113	