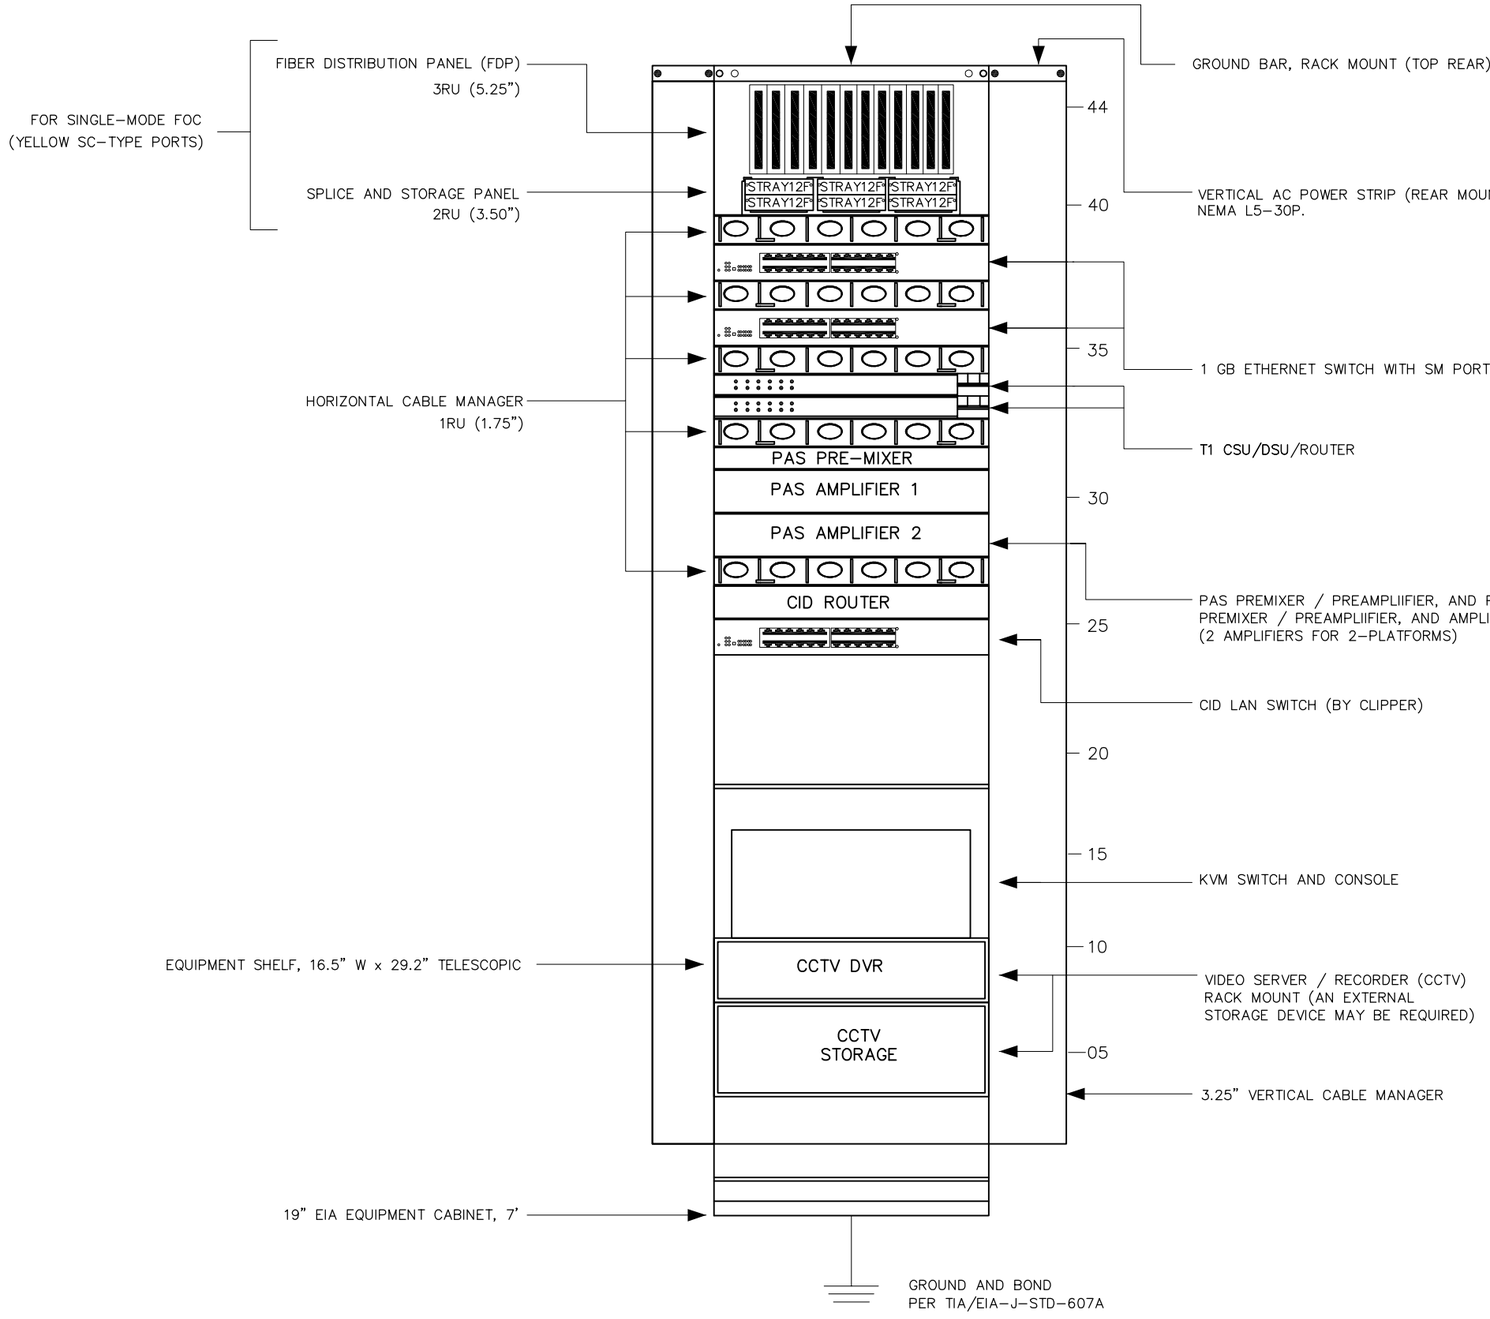

NOTES:

1. EQUIPMENT CABINET LOCATED IN COMMUNICATIONS EQUIPMENT ROOM (CER)
2. CONNECT VERTICAL AC STRIP TO L5-30A, 120VAC UPS CIRCUIT. STRIP INCLUDES (10) NEMA5-20P RECEPTACLES

REV	DATE	BY	CHK	APP	DESCRIPTION

REV	DATE	BY	CHK	APP

PENINSULA CORRIDOR JOINT POWERS BOARD

APPROVED BY:

ENGINEERING MANAGER

DEPUTY DIRECTOR OF ENGINEERING

Caltrain

1250 San Carlos Avenue
San Carlos, CA 94070

STANDARD DRAWINGS

STATION COMMUNICATIONS
SUPPORTING SYSTEM AND OTHERS
COMMUNICATIONS EQUIPMENT ROOM (CER)
RACK VERTICAL PROFILE

CADD FILE NO.:	SD-4803
REV: 0	DATE: 093011
STATION COMMS	
STANDARD NO.:	SD-4803