


NOTES:

1. EQUIPMENT CABINET LOCATED IN COMMUNICATIONS DISTRIBUTION CABINET (DC). REFER TO DIVISION 17 SPECIFICATIONS FOR STANDARDS
2. CONNECT VERTICAL AC STRIP TO L5-30A, 120VAC OPS CIRCUIT. STRIP INCLUDES (10) NEMA5-20P RECEPTACLES
3. DISTRIBUTION CABINETS WILL UTILIZE TWO SETS OF POWER SUPPLIES: (1) ESSENTIAL POWER (BACKED BY UPS AT CER) 12V AC, 30 AMP; AND NON-ESSENTIAL POWER 120V AC, 20 AMP

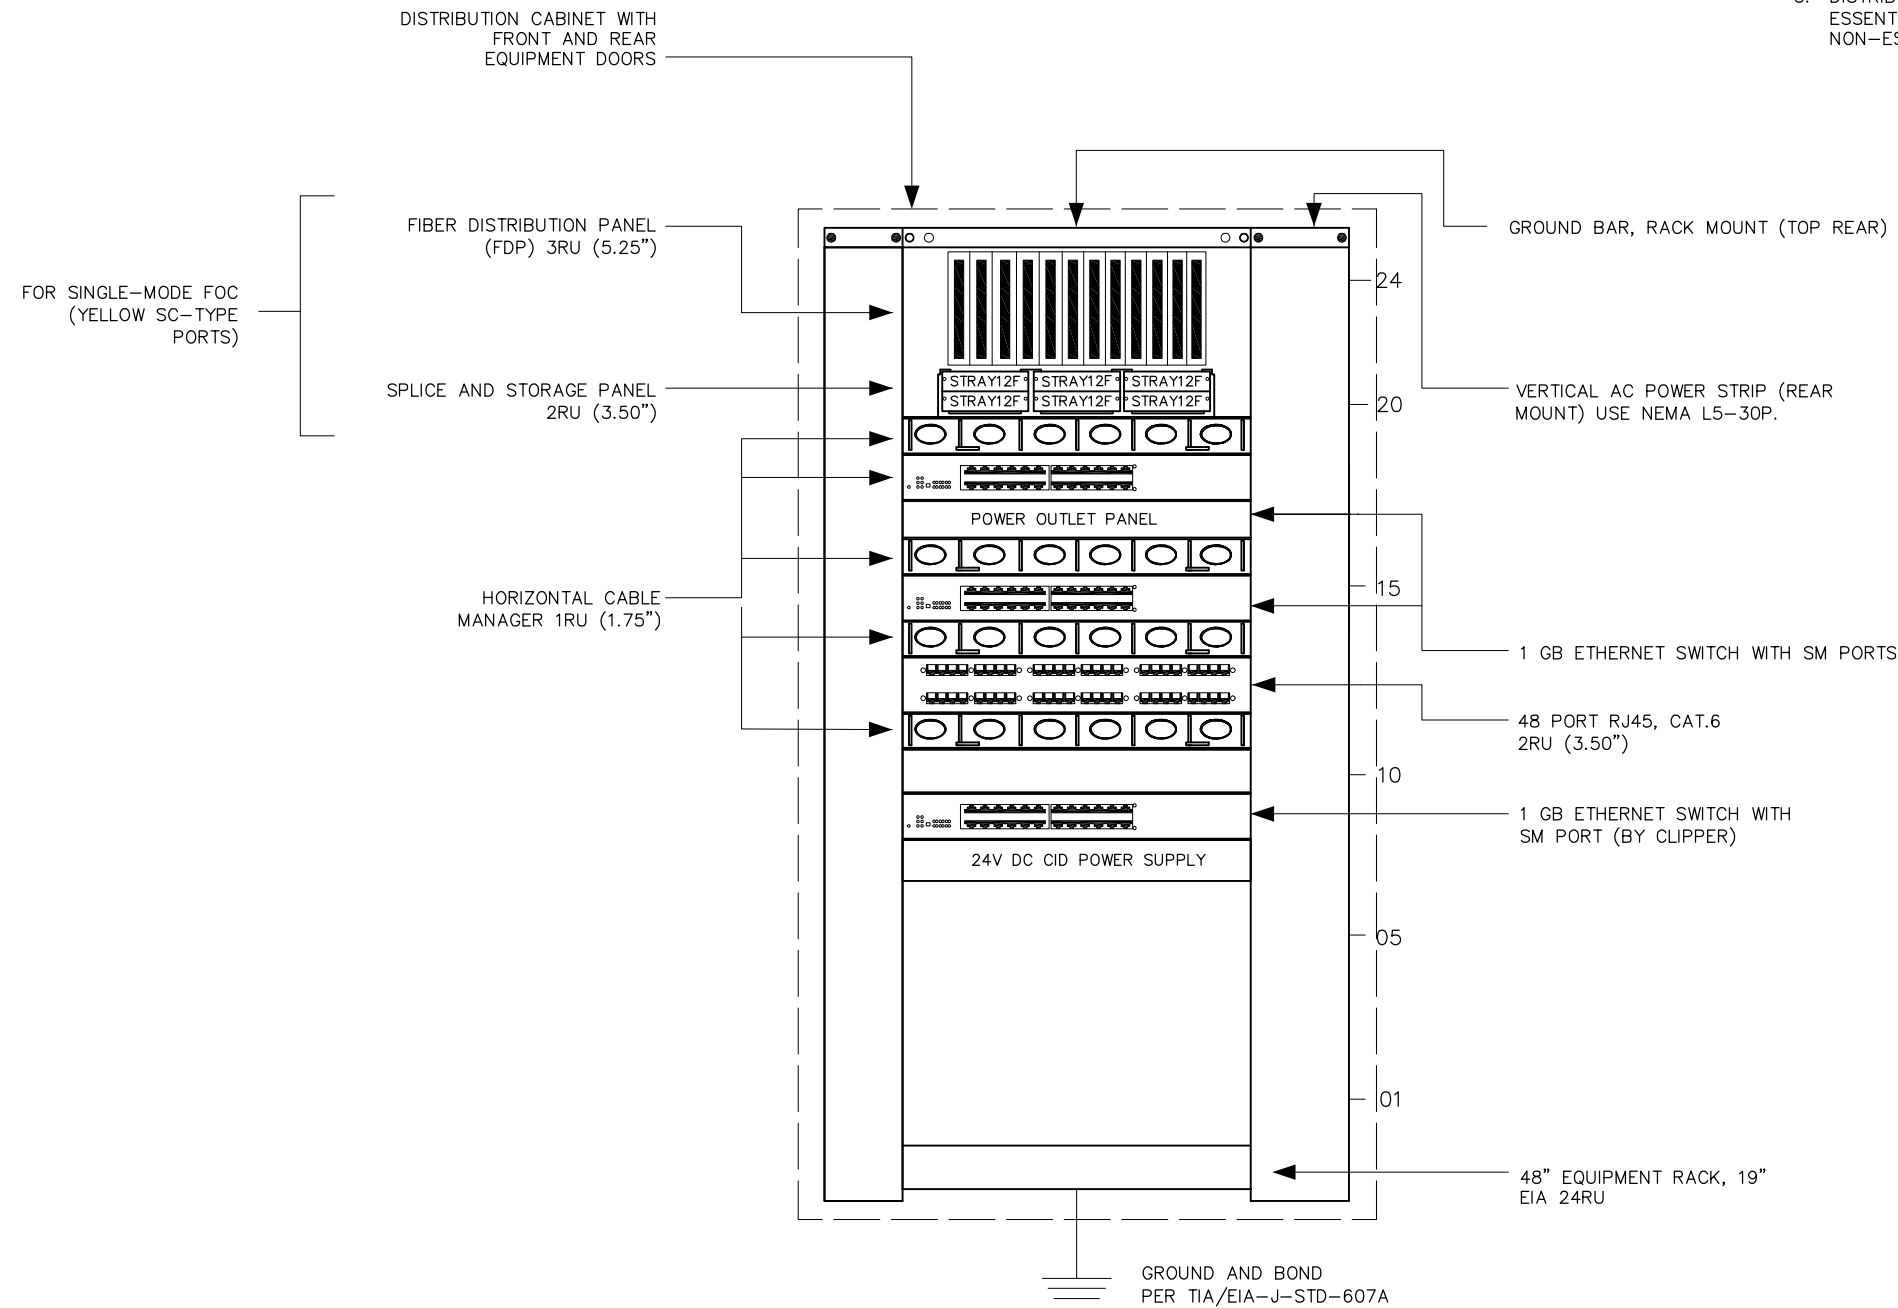

PENINSULA CORRIDOR JOINT POWERS BOARD

STANDARD DRAWINGS

CADD FILE NO.: SD-4804

REV	DATE	BY	CHK	APP	DESCRIPTION

APPROVED BY:

Bernard Anagnostis *Steph Chen*

ENGINEERING MANAGER DEPUTY DIRECTOR OF ENGINEERING



STATION COMMUNICATIONS SUPPORTING SYSTEM AND OTHERS DISTRIBUTION CABINET VERTICAL PROFILE

REV	DATE
0	093011

STATION COMMS

STANDARD NO.: SD-4804