


**NOTES:**

1. LABEL EACH FRONT PANEL FIBER PORT TO CORRELATE WITH ASSIGNED DISTRIBUTION FIBER CABLE AND STRAND
2. MOUNT PANELS IN COMMUNICATIONS CABINETS OR RACKS (19" EIA MOUNT)
3. USE FIBER DISTRIBUTION PANEL FOR SINGLE-MODE AND FOC
4. FIBER PORTS WILL BE COLORED YELLOW FOR SINGLE-MODE FOC
5. OPTION TO CONSERVE RACK SPACE: INCREASE FDP TO 96 PORTS (96 SM), MAINTAIN SM COLOR CODE

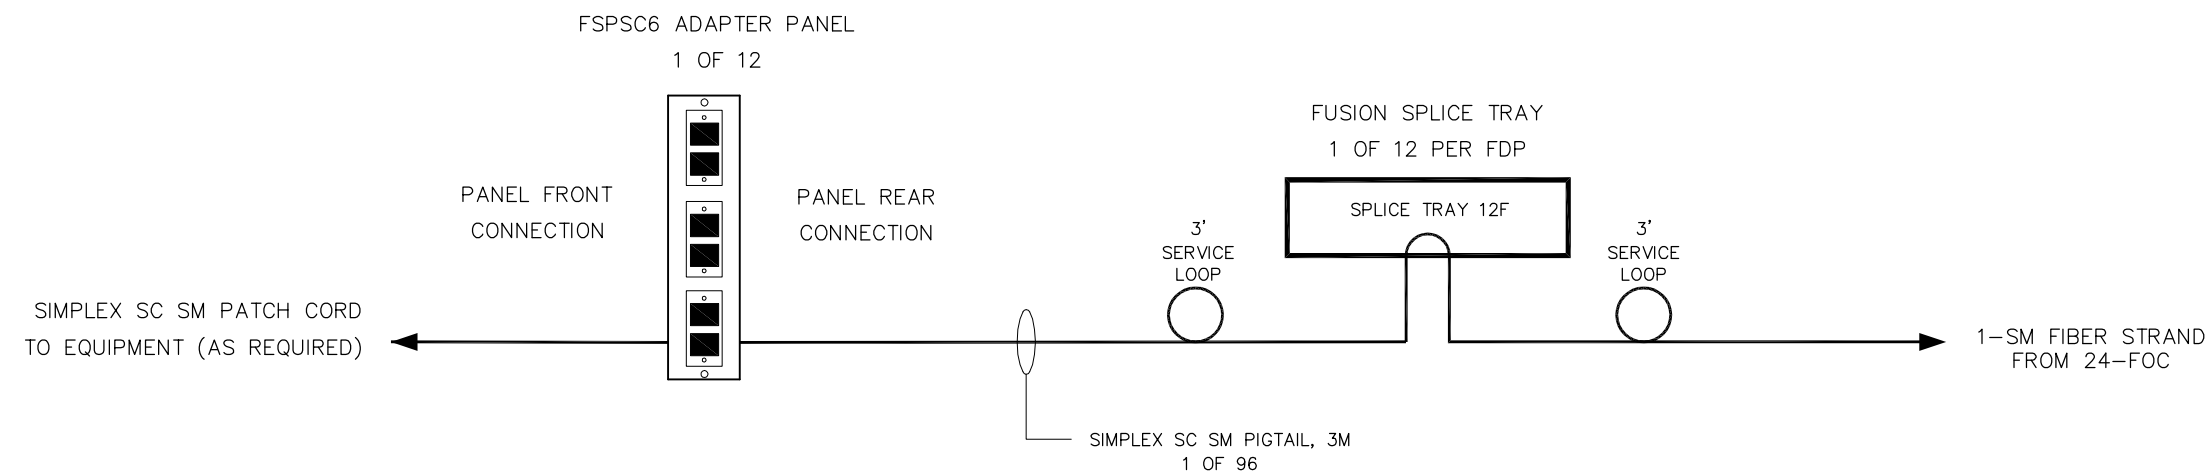

REV	DATE	BY	CHK	APP	DESCRIPTION

**PENINSULA CORRIDOR JOINT POWERS BOARD**

APPROVED BY:

ENGINEERING MANAGER

DEPUTY DIRECTOR OF ENGINEERING

1250 San Carlos Avenue  
San Carlos, CA 94070

STANDARD DRAWINGS		CADD FILE NO.:
STATION COMMUNICATIONS SUPPORTING SYSTEM AND OTHERS FIBER SPLICE AND TERMINATION PANELS EQUIPMENT AND WIRING DETAILS		SD-4834
REV	DATE	
0	093011	
STANDARD NO.:		SD-4834